

C.No-154516/2018/D18(29)

20/06/18
21/06/18

OFFICE OF EXECUTIVE ENGINEER (WS)
WATER SUPPLY DIVISION
CIVIL ENGINEERING DEPARTMENT
NEW DELHI MUNICIPAL COUNCIL
ROOM NO.231 S.B.S PLACE
GOLE MARKET: NEW DELHI - 110001

No. EE(W/S)/ 981 /D.

Dated: **19.06.2018**

The Director (IT),
New Delhi Municipal Council,
Palika Kendra,
New Delhi-110001.

Subject:-Request for insertion of enclosed RFP Corrigendum-3rd


Name of work:-Providing 24x7 Water Supply in NDMC Area.

SH:-Replacement of House Service Connection AMR Meters, Water Quality Sensors, etc. and Assessment of NRW for continuous Water Supply System (Part-I) in NDMC Area.

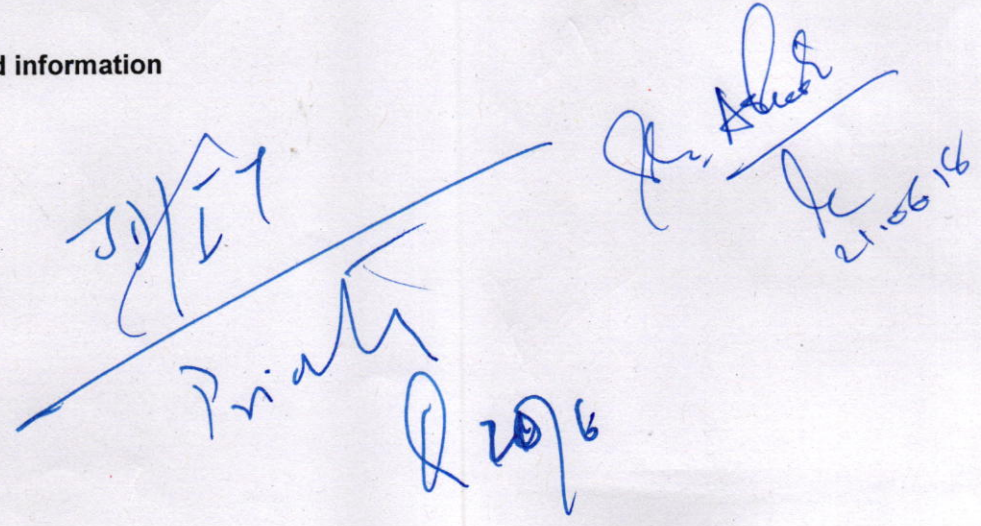
RFP ID No.2018_NDMC_150823_1 dt. 12.05.2018

The above said RFP corrigendum-2nd has been published on e-procurement system on 01.06.2018, with revised last date of submission of RFP documents on 03.07.2018 at 3.00 PM.

Director (IT) may be requested to get display the said RFP on NDMC website www.ndmc.gov.in (soft copy of RFP document enclosed herewith).


EXECUTIVE ENGINEER (WS)

Copy to:
SE (PH) for kind information


Handwritten notes: "Printed 20/6", "21/06/18", and a signature.